

# A Typical 200 Ampere Residential Mast Service Entrance



Engineering Department  
440 Highland Ridge Road  
Marietta, OH 45750  
Phone: (740) 373-2141  
Fax: (740) 885-5916

**Note:** All current National Electric Code requirements will be the responsibility of the consumer prior to connection.


**MAST NOTE:** If mast requires more than one section of conduit, the longest section of conduit shall be on top.

If outside meter socket is more than 6 feet from inside main panel box after coming through the wall, an outside main disconnect will be required.

One could either add a disconnect under the meter socket, or use a combination meter socket / disconnect. A (4) wire entrance circuit will then need to be utilized.

Meter socket, 4 terminal, ringless type, 3-wire (with grounding lug), 1 phase, 600 volt, 200 ampere rated.

To be mounted between 4 feet 6 inches and 6 feet above ground line.

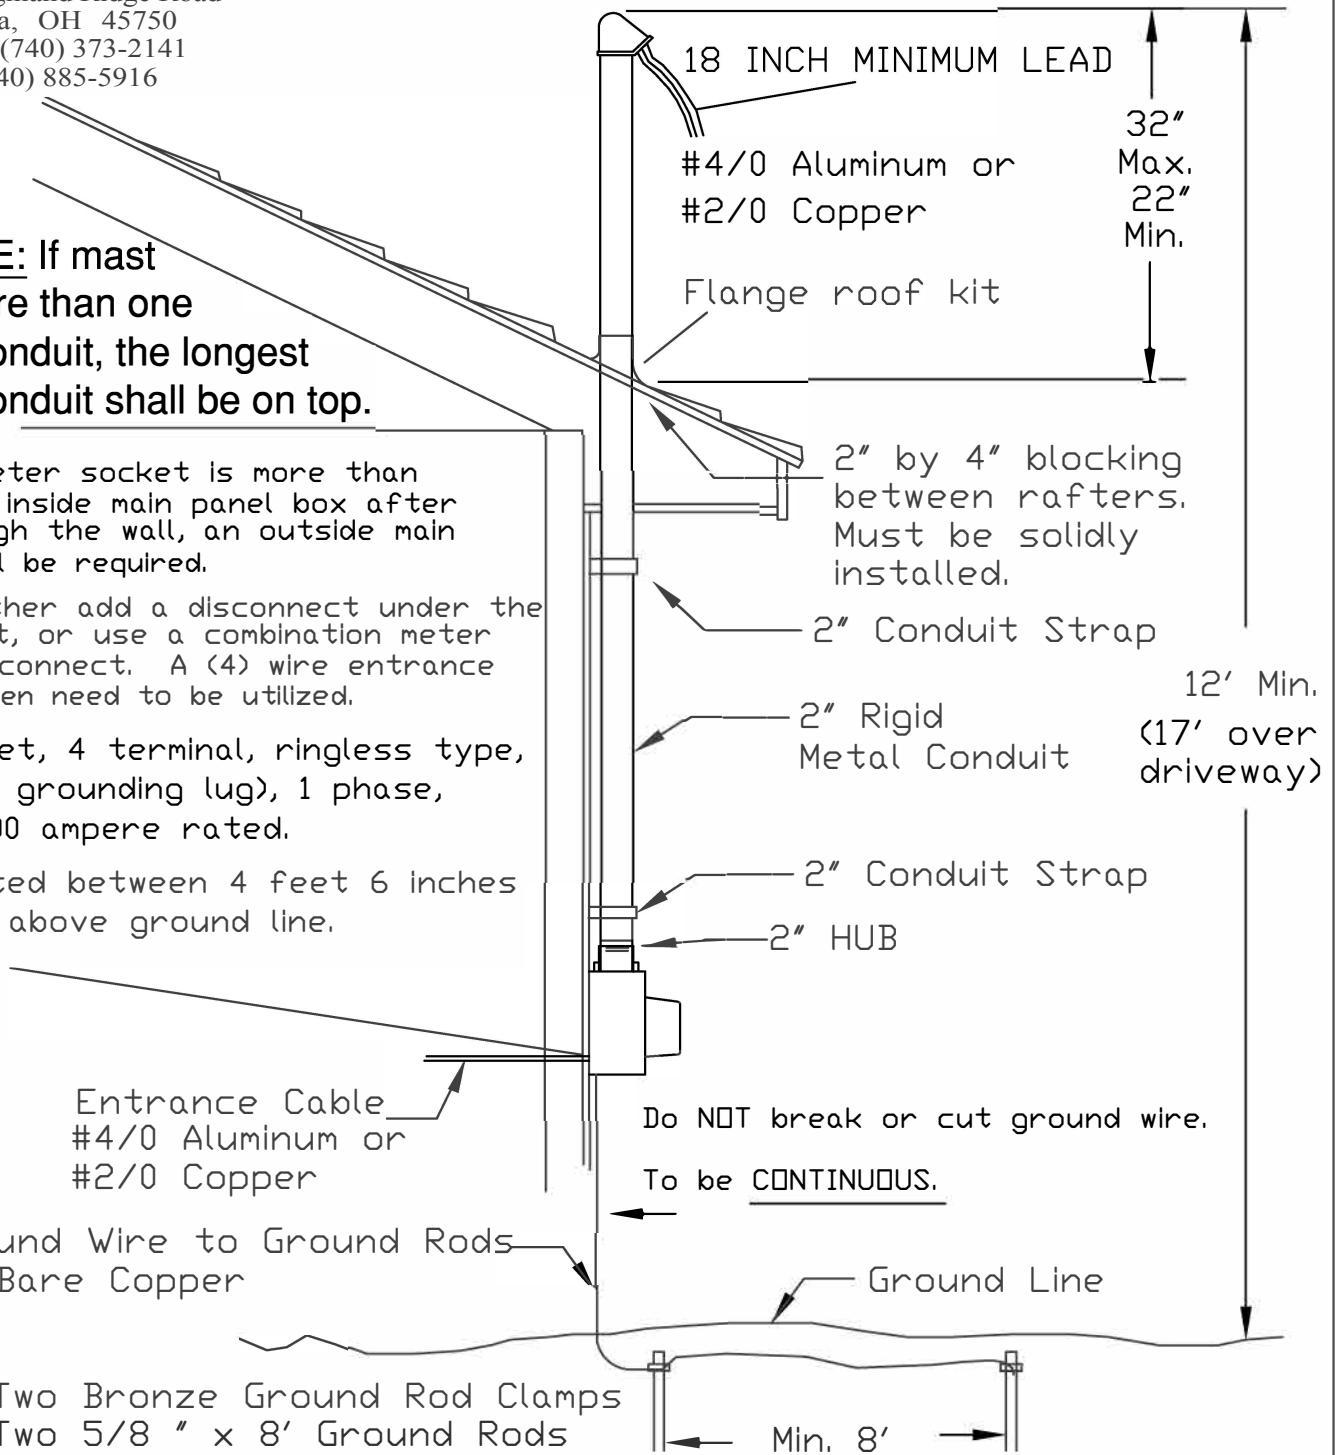

**NOTE:** Ground wire to run from meter socket or breaker panel and connect the two ground rods with one continuous wire.

**WARNING - AT NO TIME SHOULD YOU PUT COPPER AND ALUMINUM TOGETHER UNDER THE SAME CONNECTOR. CORROSION INHIBITOR TO BE USED ON ALL ALUMINUM CONNECTIONS.**